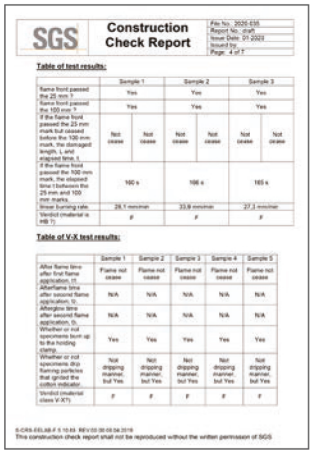
SGS Construction Check Report

File No.: 2020-035
Report No.: draft
Issue Date: 01-2020
Issued by:
Page: 4 of 7

Table of test results:

	Sample 1		Sample 2		Sample 3	
Flame front passed the 25 mm ?	Yes		Yes		Yes	
Flame front passed the 100 mm ?	Yes		Yes		Yes	
If the flame front passed the 25 mm mark but ceased before the 100 mm mark, the damaged length, L and elapsed time, t.	Not cease	Not cease	Not cease	Not cease	Not cease	Not cease
If the flame front passed the 100 mm mark, the elapsed time t between the 25 mm and 100 mm marks.	160 s		166 s		165 s	
Linear burning rate.	28.1 mm/min		33.9 mm/min		27.3 mm/min	
Vendor (material is HB ?)	F		F		F	

Table of V-X test results:

	Sample 1	Sample 2	Sample 3	Sample 4	Sample 5
After flame time after first flame application, t1	Flame not cease	Flame not cease	Flame not cease	Flame not cease	Flame not cease
Afterflame time after second flame application, t2	N/A	N/A	N/A	N/A	N/A
Afterglow time after second flame application, t3	N/A	N/A	N/A	N/A	N/A
Whether or not specimens burn up to the holding clamp.	Yes	Yes	Yes	Yes	Yes
Whether or not specimens drip flaming particles that ignited the cotton indicator.	Not dripping manner, but Yes	Not dripping manner, but Yes	Not dripping manner, but Yes	Not dripping manner, but Yes	Not dripping manner, but Yes
Vendor (material class V-X?)	F	F	F	F	F

S-CRS-EELAB-F 5.10-03 REV:00 00-08-04.2019
This construction check report shall not be reproduced without the written permission of SGS

SGS Construction Check Report

File No.: 2020-035
Report No.: draft
Issue Date: 01-2020
Issued by:
Page: 5 of 7

Halogen test

TEST	SAMPLE
HALOGEN CONTENT	Pass

HALOGEN CONTENT	RESULTS
Fluorine content (F)	Not detected
Chlorine content (Cl)	Not detected
Bromine content (Br)	Not detected
Iodine content (I)	Not detected

TEST	TEST METHOD	REPORTING LIMIT
HALOGEN (F, Cl, Br, I) CONTENT	REFERENCE IEC 61 (2006)	50mg/m

TEST	SAMPLE	
Specific Optical Density of Smoke	Pass	
	NON-FLAMING	FLAMING
Ds @ 1.5 min (average)	0.3	0.2
Ds @ 4.0 min (average)	0.6	0.6
Dm (average)	0.3	75.5
Smoke(Ds) (average)	0.6	72.4

TEST	TEST METHOD	REPORTING LIMIT
Specific Optical Density of Smoke	ASTM D562-10	Ds1.5 min, 100 Ds4 min, 200

S-CRS-EELAB-F 5.10-03 REV:00 00-08-04.2019
This construction check report shall not be reproduced without the written permission of SGS

Halogen Free Belgeleri

5 YIL GARANTİ

Buat ve Pano Kutuları

Alüminyum - Plastik

YERLİ ÜRETİM

Buat ve Pano Kutuları

Üreten Ülke Güçlüdür